


NOTES:

1. INSERTA-TEES ALLOWED ON EXISTING PVC OR DUCTILE IRON SEWER MAINS 10" IN DIA. OR LARGER. SERVICE SADDLES SHALL BE USED ON EXISTING 8" CONCRETE OR AC PIPES (DETAIL 25). MANUFACTURED TEE FITTINGS SHALL BE USED ON ALL NEWLY CONSTRUCTED MAINLINES,
2. THE TAP SHALL NOT BE MADE EXCEPT IN THE PRESENCE OF A CITY INSPECTOR; NOR SHALL ANY CONNECTION BE MADE WITHOUT CITY APPROVAL.
3. CENTERLINE OF TAP SHALL BE ABOVE SPRINGLINE.

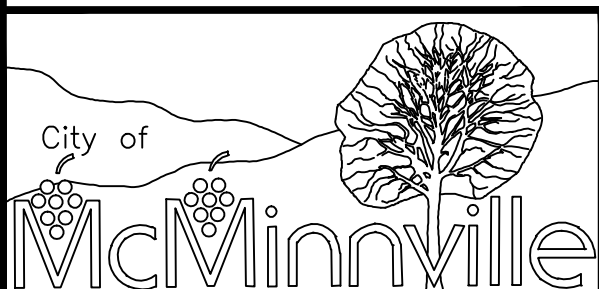

DETAIL FOR
INSERTA-TEE CONNECTION
TO EXISTING SEWER

DATE:
AUGUST 2009

DRAWING NO.
24